


1. Joist Closer than 18" to Soil or Girders Less Than 12" Shall be Pressure Treated or Decay Resistant Wood
2. Concrete Footings Shall be 12" into Undisturbed Soil
3. Stem Wall Shall be Self Supported and Not Rest on Manufactured Home

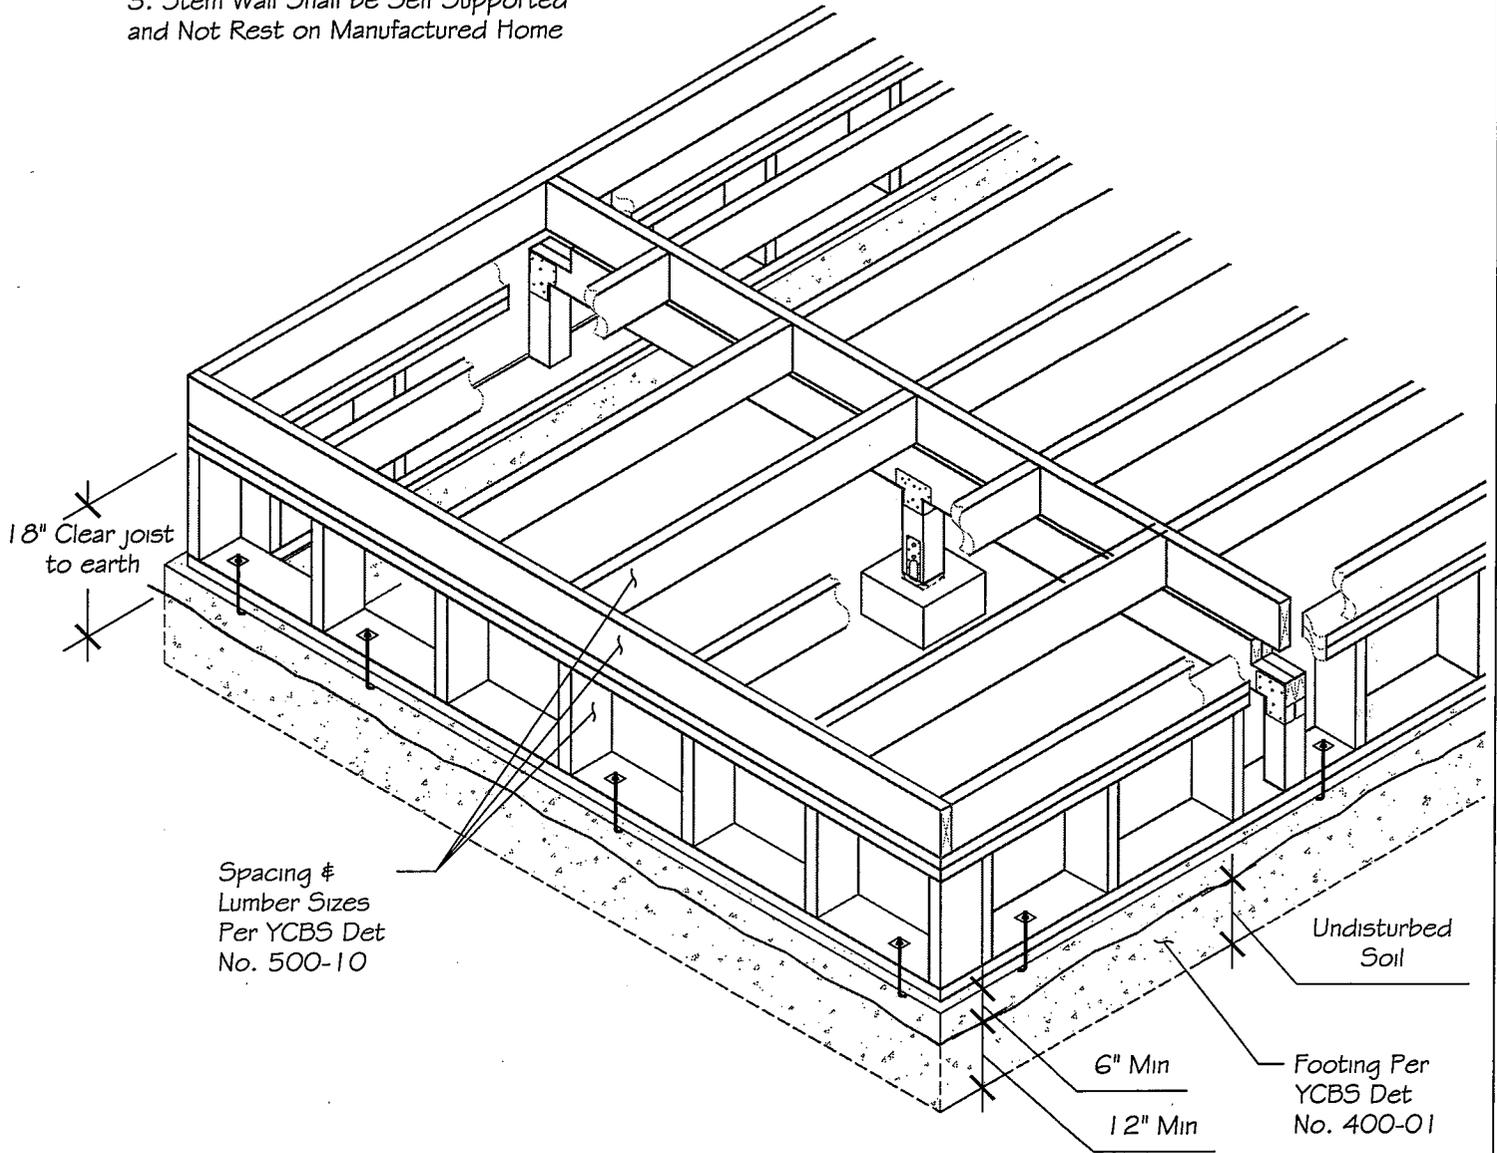

|  |  |                   |                    |
|--|--|-------------------|--------------------|
| Floor Framing                                  |  | Date Approved     | 3/2010             |
| Stem Wall                                      |  | Building Official | <i>[Signature]</i> |
| Building Safety                                |  | Updated           | 11/2010            |
| Yuma County Department of Development Services |  | YCBS Det No.      | 500-11             |