


Min 1/2" Ø Lag Screws w/ Washers,  
 Staggered 24" O.C. Min 2"  
 Penetration into Existing Framing  
 Lumber. Min 2 Lag Screws at  
 Ends or Splices.

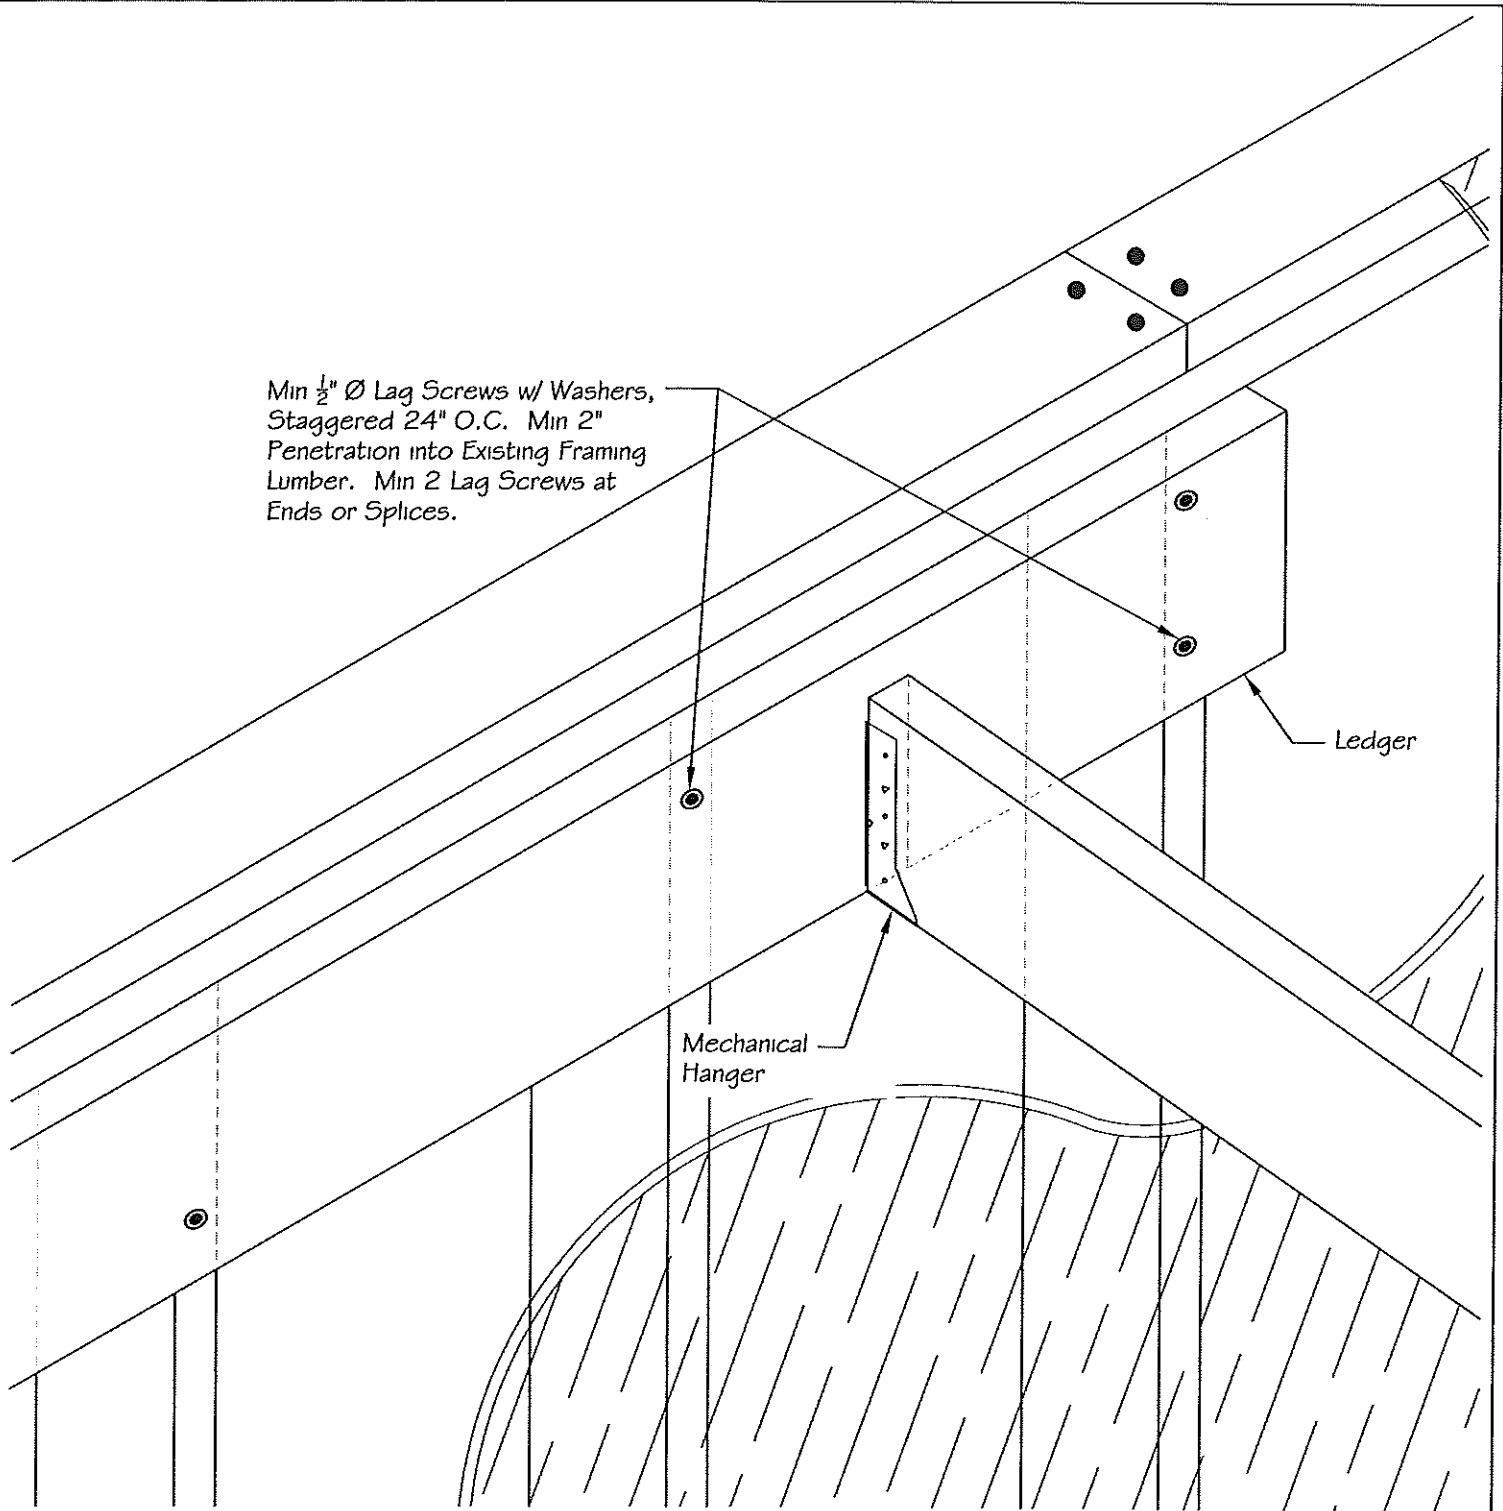

Ledger

Date Approved 3/2011

Building Official *[Signature]*

Ledger Attachment Detail

Updated 11/2010

Building Safety Yuma County Department of Development Services

YCBS Det No. 600-11

